


CONCRETE STEPS

FOR 1, 2, and 3 Family Residences

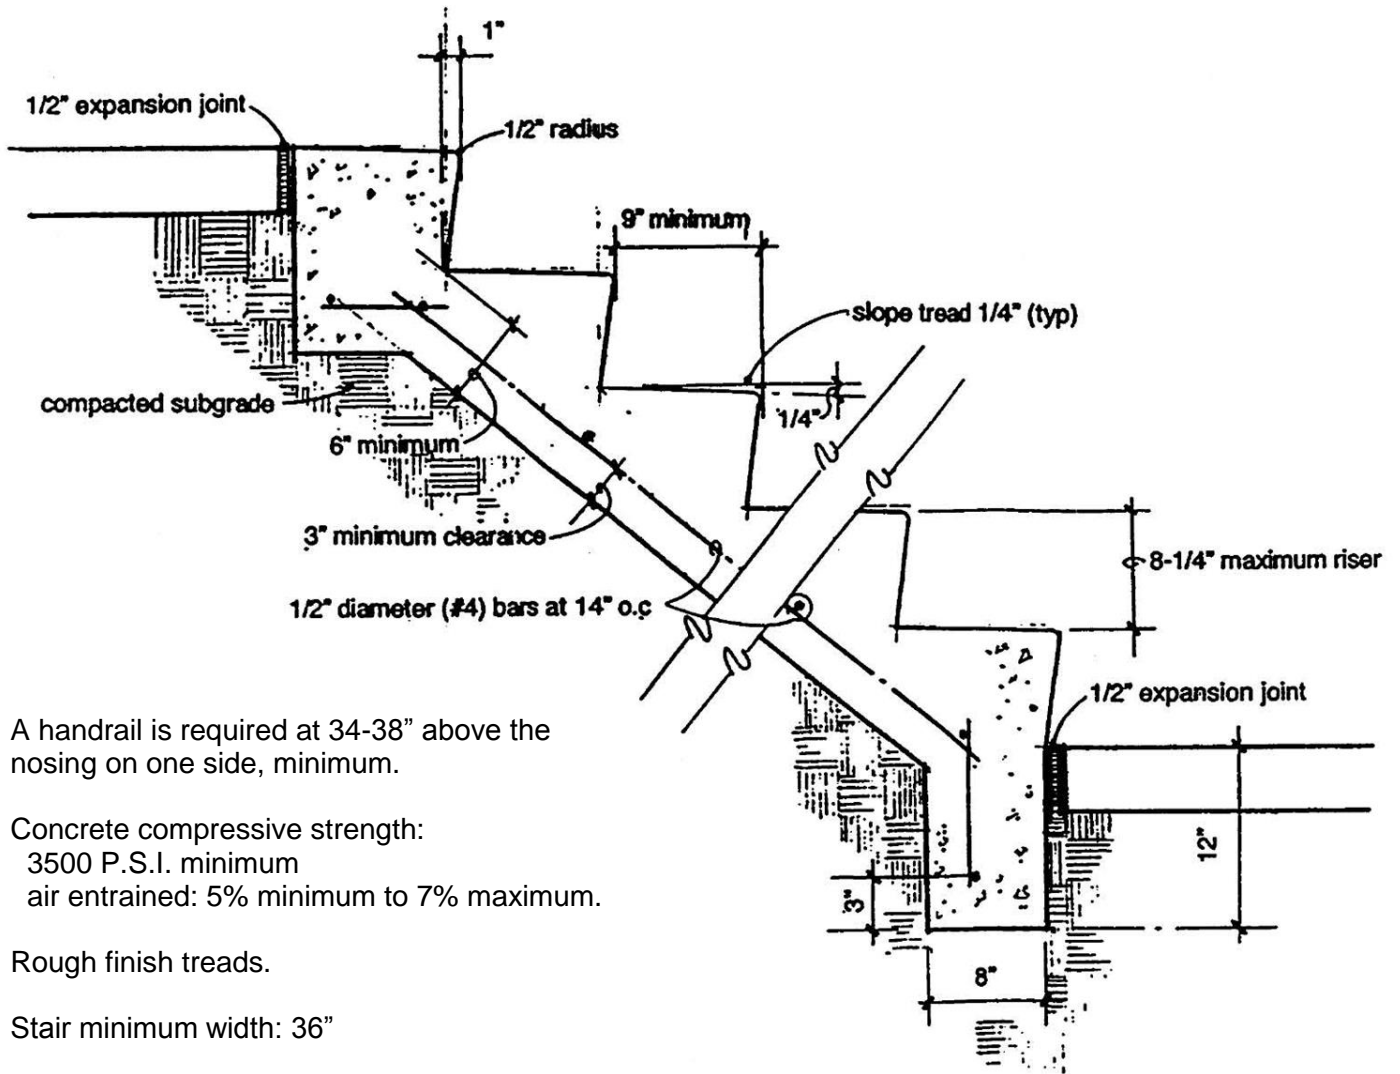

A handrail is required at 34-38" above the nosing on one side, minimum.

Concrete compressive strength:
3500 P.S.I. minimum
air entrained: 5% minimum to 7% maximum.

Rough finish treads.

Stair minimum width: 36"

Tread lengths must be uniform.

Riser heights must be uniform.

Landings shall be provided at the top and bottom of each stairway (min. 36" measured in the direction of egress travel).

OWNER _____

ADDRESS _____